


Fixture Family: 47R


Description: 47R Series - Flange Installation Instructions

IMPORTANT SAFETY INSTRUCTIONS


- This product must be installed in accordance with all applicable installation codes by a person familiar with the construction and operation of the product and the hazards involved.
 - Disconnect power before beginning installation.
 - Fixture must be installed in compliance with the National Electric Code and any local codes.
 - To be installed only by a qualified electrician.
- Proper grounding is required to ensure personal safety.
 - Read all fixture markings and labels to ensure correct installation of fixture.
 - Risk of fire, use minimum of 90C supply connectors.
 - These instructions may not cover all details or variations. If additional information is needed, please contact New Star Lighting.




2x4 CEILING CUTOUT



2x2 CEILING CUTOUT




1x4 CEILING CUTOUT



1x2 CEILING CUTOUT

VERIFY CEILING CUTOUT DIMENSIONS BEFORE INSTALLATION

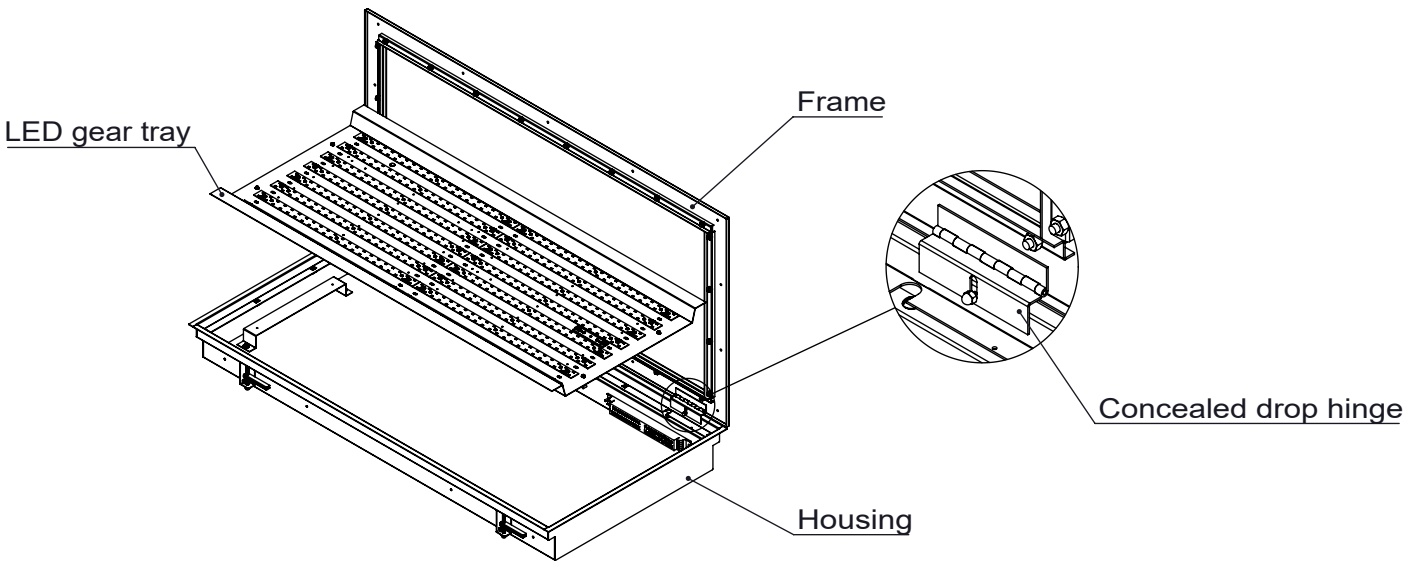

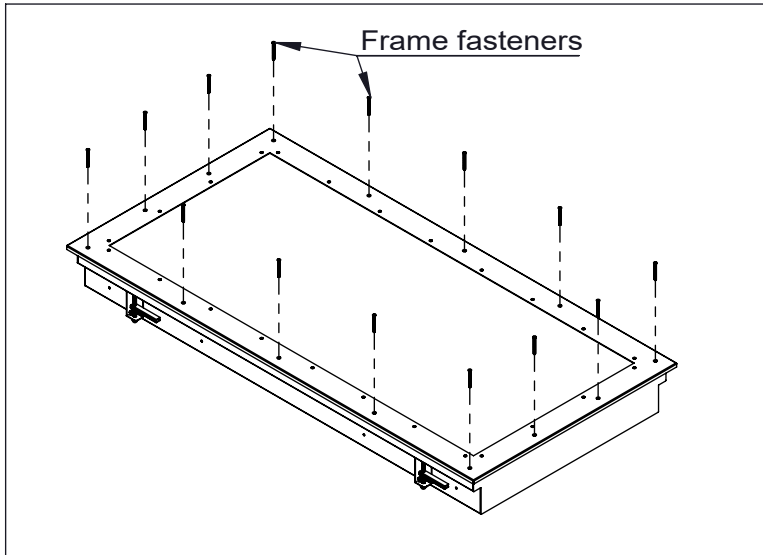


Figure 1

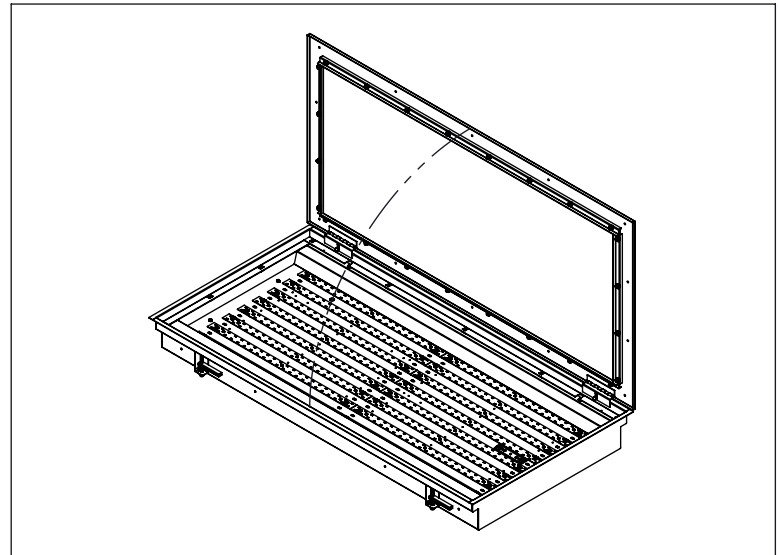


Figure 2

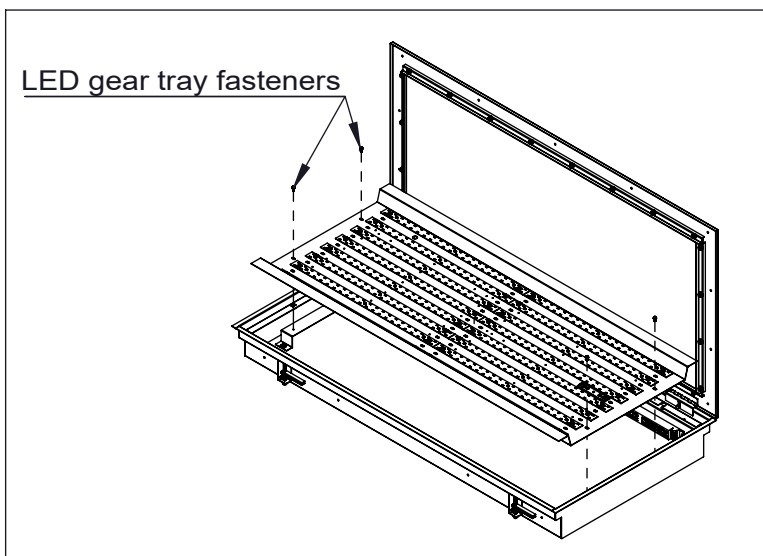


Figure 3

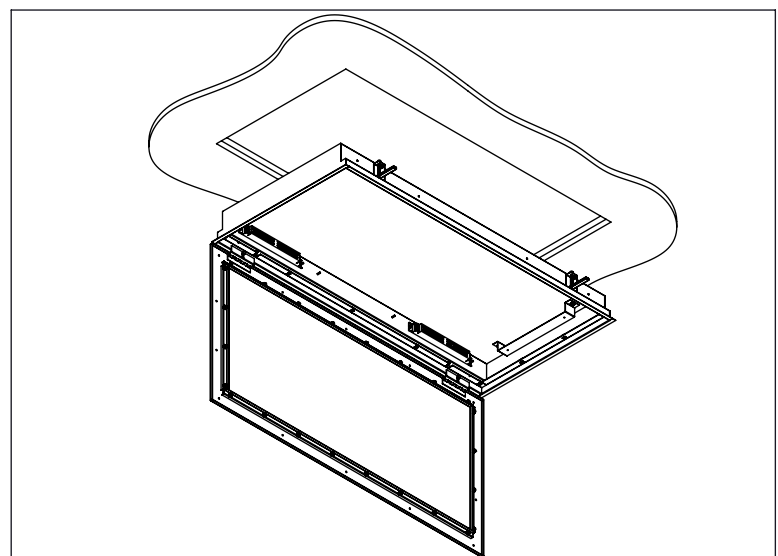


Figure 4

INSTALLATION STEPS

1. Remove frame fasteners (Fig. 1) and open frame (Fig. 2).
2. Remove LED gear tray fasteners and LED gear tray (Fig. 3).
3. Raise housing into ceiling (Fig. 4).

Installer is responsible for adequately reinforcing walls and/or ceiling to support luminaire weight. These instructions do not claim to cover all details or variations in the equipment, procedure, or process. Specifications and dimensions are subject to change.

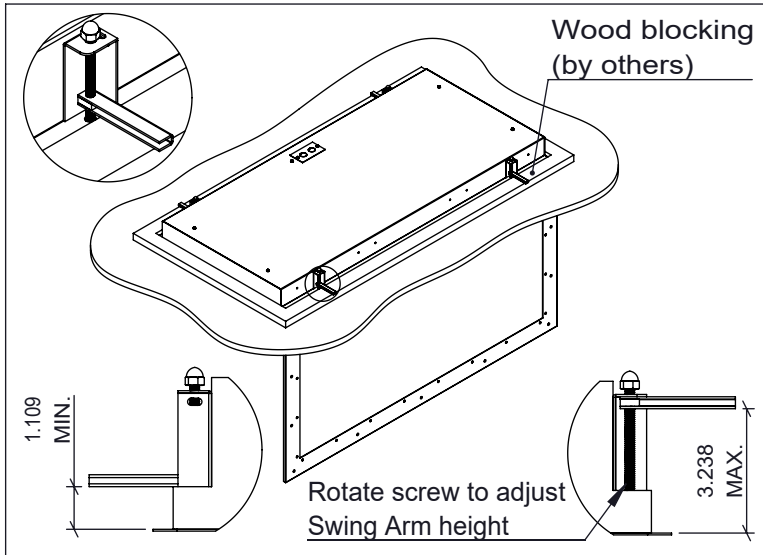


Figure 5

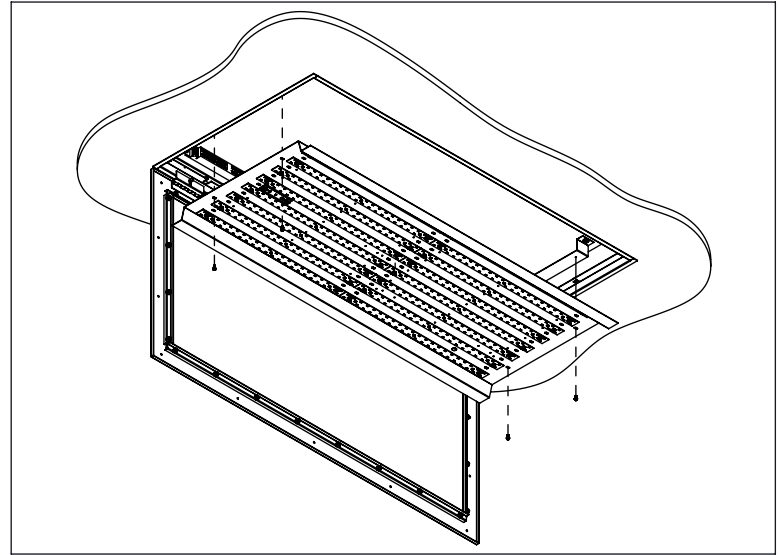


Figure 6

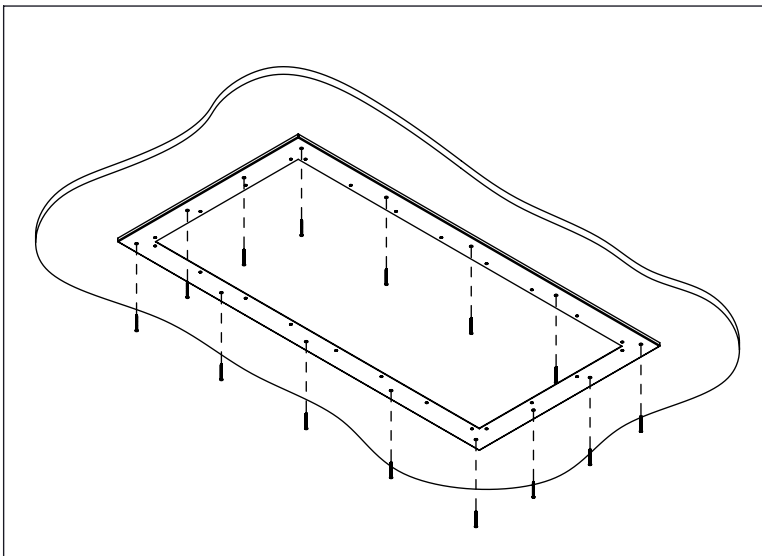


Figure 7

INSTALLATION STEPS

4. Adjust swing arms to the proper height (Fig. 5).
5. Make all necessary electrical connections, then reinstall LED gear tray (Fig. 6).
6. Close frame door and secure with frame fasteners (Fig. 7).

Installer is responsible for adequately reinforcing walls and/or ceiling to support luminaire weight. These instructions do not claim to cover all details or variations in the equipment, procedure, or process. Specifications and dimensions are subject to change.