


PROJECT: _____
 TYPE: _____
 PRODUCT: _____
 APPROVED BY: _____

PRODUCT FEATURES

- Intended for MRI suites
- Non-ferrous construction and remote power supplies provide safe operating conditions for MRI machines, medical imaging equipment, and other magnetically sensitive apparatus
- Non-ferrous 16-gauge aluminum construction with tool-free room-side lens removal to access LED boards
- Available in 1x1, 1x2, 1x4, 2x2, and 2x4 dimensions
- Provides glare-free ambient lighting, up to 12,200 delivered lumens in the 2x4
- This product is Made in America and complies with the Buy American Act (BAA), and the Build America, Buy America Act (BABAA)

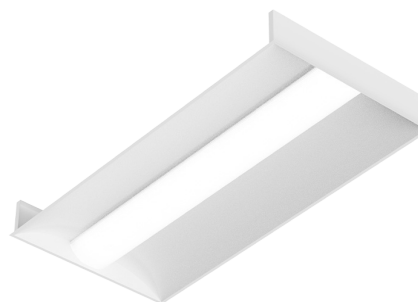

AAOM

ORDERING INFORMATION

EXAMPLE: AAOMG11-HA16-L340-1C-RW-90C-UN



AAOM			HA16		
Series	Mounting G = Grid	Size* 11 = 1x1 12 = 1x2 14 = 1x4 22 = 2x2 24 = 2x4 *Nominal Size. Dimensional Data on Page 2.	Housing HA16 = 16Ga. Aluminum Painted	Lumen Output* L2 = Low L3 = Standard L4 = High CL = Custom Lumen Output** *Subject to change. **Must be specified at time of quote. Must not exceed fixture maximum output.	Color Temp. 30 = 3000K 35 = 3500K 40 = 4000K 50 = 5000K

Circuits 1C = 1 Circuit	Diffuser RW = White Polycarbonate	CRI 90C = 90 CRI	Voltage 12 = 120V 27 = 277V UN = Universal (120-277V)	Driver DM = 0-10V dimming with 10-100% range DMI = 0-10V dimming with 1-100% range	Accessory FK = Flange Conversion Kit *Consult factory for details.
-----------------------------------	---	----------------------------	---	---	---

POWER ENCLOSURE ORDERING INFORMATION

EXAMPLE: AAOM24-PS-L2-2-DM

AAOM		PS			
Series	Size 11 = 1x1 12 = 1x2 14 = 1x4 22 = 2x2 24 = 2x4	PS = Power Enclosure* *Up to 8 drivers can be in a Power Enclosure depending on quantity of fixtures ordered. Consult factory for custom configurations. Configuration must be determined at time of order.	Lumen Output L2 = Low L3 = Standard L4 = High CL = Custom Lumen Output	Drivers per Fixture* **Please refer to chart on page 5. Requires proper filtration components, by others. Each driver requires a filter.	Options DM = 0-10V dimming with 10-100% range DMI = 0-10V dimming with 1-100% range



New Star Lighting
 2225 W Pershing Rd, Chicago, IL 60609
 (773) 847-1400
www.newstarlighting.com

Specifications and dimensions are subject to change without notice. For additional options and dimensional details, please consult your New Star Lighting representative.

© 2025, New Star Lighting. All rights reserved. Unauthorized duplication or distribution is prohibited.

SPECIFICATIONS

HOUSING: Non-ferrous 16-gauge aluminum housing with continuous seam welds.

LENS: Extruded white polycarbonate lens (smooth side out) serves as a diffuser for direct ambient light. Unique clip design allows for tool-free lens removal to access LED boards.

LED: LED sources available in four color temperatures 3000K, 3500K, 4000K and 5000K with maximum 3-step MacAdam variation allowance. Other color temperatures available, consult factory. Minimum 50,000 hours with 70% lumen maintenance in a 25°C ambient temperature environment, compliant with IES LM-80 testing standards.

ELECTRICAL: 120-277VAC 50/60HZ electrical input high power factor electronic, constant current driver (<20% THD, >0.90 PF). Standard 0-10V dimming with 1-100% range.

REMOTE POWER SUPPLY: LED driver included - must be remote mount. Must order Power Supply separately on page 2. Consult factory for more information. MRI room EMI filter required, supplied by others.

FINISH: White antimicrobial polyester powder coat finish following multi-stage iron phosphate pre-treatment on all exposed room-side painting surfaces, unless otherwise specified.


INSTALLATION: Grid installation standard. Optional kit for flange mounting, must specify under accessory.

WARRANTY: Five Year Warranty.

LABEL: Fixture is certified to UL standards by Intertek Testing Laboratories for Damp Locations. This product is Made in America and complies with the Buy American Act (BAA), and the Build America, Buy America Act (BABAA).

DIMENSIONAL DATA

*Note, below dimensional data shows "L4 = High" lumen output. LED board configuration subject to change based on specified lumen output.

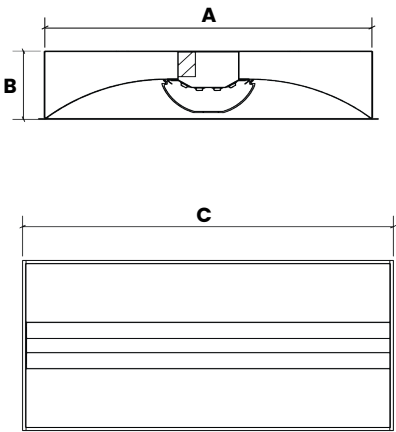

	A	B	C
AAO11	11.750"	5.174"	11.750"
AAO12	11.750"	5.174"	23.750"
AAO14	11.750"	5.174"	47.688"
AAO22	23.750"	5.174"	23.750"
AAO24	23.750"	5.174"	47.688"

PERFORMANCE DATA*

*LEDs are frequently updated therefore values may change without notice.

MODEL	OUTPUT	COLOR TEMP.	LUMENS DELIVERED	EFFICACY (lm/W)	INPUT POWER (W)
AAOM11	L2 = Low	3000K	1275	102	12.5
		3500K	1338	107	12.5
		4000K	1375	110	12.5
		5000K	1413	113	12.5
	L3 = Standard	3000K	1800	100	18
		3500K	1890	105	18
		4000K	1945	108	18
		5000K	2000	111	18
	L4 = High	3000K	2425	97	25
		3500K	2550	102	25
		4000K	2625	105	25
		5000K	2700	108	25
AAOM12	L2 = Low	3000K	2450	98	25
		3500K	2575	103	25
		4000K	2650	106	25
		5000K	2725	109	25
	L3 = Standard	3000K	3610	95	38
		3500K	3800	100	38
		4000K	3914	103	38
		5000K	4028	106	38
	L4 = High	3000K	4600	92	50
		3500K	4850	97	50
		4000K	5000	100	50
		5000K	5150	103	50
AAOM14	L2 = Low	3000K	5500	110	50
		3500K	5750	115	50
		4000K	5900	118	50
		5000K	6050	121	50
	L3 = Standard	3000K	8025	107	75
		3500K	8400	112	75
		4000K	8625	115	75
		5000K	8850	118	75
	L4 = High	3000K	10400	104	100
		3500K	10900	109	100
		4000K	11200	112	100
		5000K	11500	115	100



New Star Lighting

2225 W Pershing Rd, Chicago, IL 60609
(773) 847-1400
www.newstarlighting.com

Specifications and dimensions are subject to change without notice. For additional options and dimensional details, please consult your New Star Lighting representative.

© 2025, New Star Lighting. All rights reserved. Unauthorized duplication or distribution is prohibited.

PERFORMANCE DATA CONT.

MODEL	OUTPUT	COLOR TEMP.	LUMENS DELIVERED	EFFICACY (lm/w)	INPUT POWER (W)
AAOM22	L2 = Low	3000K	2550	102	25
		3500K	2675	107	25
		4000K	2750	110	25
		5000K	2825	113	25
	L3 = Standard	3000K	3800	100	38
		3500K	3990	105	38
		4000K	4100	108	38
		5000K	4220	111	38
	L4 = High	3000K	4900	98	50
		3500K	5150	103	50
		4000K	5300	106	50
		5000K	5450	109	50
AAOM24	L2 = Low	3000K	5700	114	50
		3500K	5950	119	50
		4000K	6100	122	50
		5000K	6250	125	50
	L3 = Standard	3000K	8175	109	75
		3500K	8550	114	75
		4000K	8775	117	75
		5000K	9000	120	75
	L4 = High	3000K	11100	111	100
		3500K	11600	116	100
		4000K	11900	119	100
		5000K	12200	122	100



New Star Lighting

2225 W Pershing Rd, Chicago, IL 60609
(773) 847-1400
www.newstarlighting.com

Specifications and dimensions are subject to change without notice. For additional options and dimensional details, please consult your New Star Lighting representative.

© 2025, New Star Lighting. All rights reserved. Unauthorized duplication or distribution is prohibited.

POWER ENCLOSURE: NUMBER OF DRIVERS PER FIXTURE

SERIES	SIZE	LUMEN OUTPUT	NUMBER OF DRIVERS PER FIXTURE
AAOM	11 = 1x1	L2 = Low	1
		L3 = Standard	1
		L4 = High	1
	12 = 1x2	L2 = Low	1
		L3 = Standard	1
		L4 = High	1
	14 = 1x4	L2 = Low	1
		L3 = Standard	2
		L4 = High	2
	22 = 2x2	L2 = Low	1
		L3 = Standard	1
		L4 = High	1
	24 = 2x4	L2 = Low	1
		L3 = Standard	2
		L4 = High	2



New Star Lighting

2225 W Pershing Rd, Chicago, IL 60609
(773) 847-1400
www.newstarlighting.com

Specifications and dimensions are subject to change without notice. For additional options and dimensional details, please consult your New Star Lighting representative.

© 2025, New Star Lighting. All rights reserved. Unauthorized duplication or distribution is prohibited.

IMPORTANT SAFETY MEASURES

Power must be supplied by grounded New Star Remote Power Supply to ensure adequate EMI filtering. Remote Power Supply system must be ordered separately, and installed according to provided instructions.

- This must be installed in accordance with the applicable installation code by a person familiar with the construction and operation of the product and the hazards involved in a MRI environment
- Disconnect power to all circuits before wiring fixture
- Install in accordance with all national, state, and local codes
- Remote Power Supply MUST be grounded
- Failure to install unit on a mechanically sound surface may result in personal injury, physical damage, or potential fire hazard
- Use installation procedures appropriate to a MRI environment and sensitive electronic equipment
- Read all fixture marketing and labels to ensure correct installation of the luminaire
- Supplemental instructions may be located on the luminaire, in addition to the instruction sheet provided by New Star, regarding orientation or mounting restrictions



New Star Lighting

2225 W Pershing Rd, Chicago, IL 60609
(773) 847-1400
www.newstarlighting.com

Specifications and dimensions are subject to change without notice. For additional options and dimensional details, please consult your New Star Lighting representative.

© 2025, New Star Lighting. All rights reserved. Unauthorized duplication or distribution is prohibited.

SPECIFIER ACKNOWLEDGMENT

Contractor acknowledges and understands the requirements of installing New Star Lighting products prior to the installation.

Please sign below before New Star Lighting releases your order.

Signature: _____

Date: _____

Print Name: _____

Project Name: _____

----- See next page for MRI installation registration checklist -----

MRI INSTALLATION REGISTRATION CHECKLIST

Customer acknowledges that attached Installation Registration Checklist will be provided to the installer to sign and return to New Star Lighting after the installation is complete.
Please fill out this form and return to your New Star Lighting Representative.

The warranty for your MRI installation will not go into effect until receipt of this signed registration checklist.

I certify that the lighting installation for the listed MRI suite is completed per the provided installation instructions and to the best of my abilities.

Please check off to denote status:

Installation instruction sheet for Remote Power Supply is read and followed.

Remote Power supply is located outside the shielded MRI exam room and grounded.

All dimming signals wiring is located outside the shielded MRI room.

Lighting system fully tested (including dimming operation if applicable) while MRI machine is in idle mode.

Lighting system fully tested (including dimming operation, if applicable) while MRI machine is in scan operation mode with the magnets fully activated.

If any of those steps cannot be completed or you need technical assistance, please contact your New Star Lighting Representative.

Electrical Contractor

Installation site

Name: _____

Project Name: _____

Phone: _____

City / State (Province): _____

Installation date: _____

Send the form to your New Star Lighting Representative.

New Star Lighting Representative: _____

Date: _____



New Star Lighting

2225 W Pershing Rd, Chicago, IL 60609
(773) 847-1400
www.newstarlighting.com

Specifications and dimensions are subject to change without notice. For additional options and dimensional details, please consult your New Star Lighting representative.

© 2025, New Star Lighting. All rights reserved. Unauthorized duplication or distribution is prohibited.