


COMPLETECARE™ MRI DOWNLIGHT SERIES

PROJECT: _____
 TYPE: _____
 PRODUCT: _____
 APPROVED BY: _____

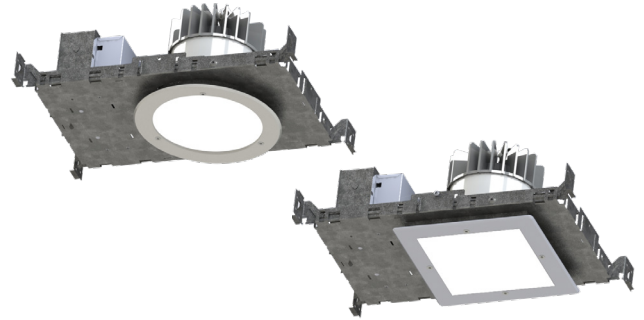

CCDL-MRI SERIES

PRODUCT FEATURES

- Intended for MRI and Hybrid Surgical Suite applications
- 4" or 6" non-ferrous, sealed downlight, round and square aperture options
- Variety of wattages and lumen packages, up to 4000 lumens
- Suitable for wet location installations, IP65 rated (from the room-side) per IEC60598 and NSF2 Splash/Non-Food Zone listed. ISO Class 3 (Fed Std. 209E/ Class 1). Optional IC-Rated housing per UL 1598 Independently tested and certified to meet the MIL Spec 461G Fixed Navy/Air Force for Radiated and Conducted emissions
- This product is Made in America and complies with Buy American Act (BAA)

HOUSING ORDERING INFORMATION

Example: CCDL-MRI-4R-SD-UN-FZ1



CCDL	MRI					
Series	MRI	Aperture 4 = 4 inch 6 = 6 inch	Shape R = Round S = Square	Lumen Output* LW = Low SD = Standard MD = Medium HG = High CL = Custom Lumens** *Subject to change. Performance data on page 3. **Must be specified at time of quote. Must not exceed fixture maximum output.	Voltage 12 = 120V 27 = 277V UN = Universal (120V-277V)	Options FZ1 = Fuse (120V) FZ2 = Fuse (277V) IC = IC Rated Housing* W = Wing Bracket CCEA = Chicago Plenum Compliant *Max 23W.

TRIM ORDERING INFORMATION

Example: CCDL-MRI-4R-30-90C-1-F-A

CCDL	MRI							A
Series	MRI	Aperture 4 = 4 inch 6 = 6 inch	Shape R = Round S = Square	Color Temp. 30 = 3000K 35 = 3500K 40 = 4000K 50 = 5000K Tunable White* TW1 = 2700K to 5000K TW2 = 2700K to 6500K *Must specify Tunable White Driver.	CRI 80C = 80 CRI 90C = 90 CRI* *N/A with 5000K. 90 CRI standard for Tunable White.	Flush Lens 1 = .125 Clear Poly. 2 = .250 Clear Poly.	Trim F = Flange	Trim Finish A = .080 Alum. Painted* *Antimicrobial standard



New Star Lighting

2225 W Pershing Rd, Chicago, IL 60609
 (773) 847-1400
www.newstarlighting.com

Specifications and dimensions are subject to change without notice. For additional options and dimensional details, please consult your New Star Lighting representative.

© 2026, New Star Lighting. All rights reserved. Unauthorized duplication or distribution is prohibited.

COMPLETECARE™ MRI DOWNLIGHT SERIES

SPECIFICATIONS

HEAT SINK: Custom diecast aluminum heat sink design for maximum thermal dissipation.

FRAME-IN KIT: Vertically adjustable collar accommodates ceiling thicknesses up to 1.25", adjustable post-installation. Telescopic hanger bars come as standard. For installation with wood T-grid ceiling systems spaced up to 24" on center.

TRIM: IP-rated trim/light engine incorporates the heat sink, LED module, optics and lower trim. Flush lens trim secured with Phillips fasteners. Closed-cell gasketing at ceiling flange.

OPTICAL: Round or square aperture with clear impact-resistant polycarbonate lens.

ELECTRICAL: LED source available in multiple CCT and CRI combinations with a maximum 3-step MacAdam variation allowance. 120-277VAC, 50/60Hz electrical input with serviceable constant current driver (<20% THD, >0.90 PF). Minimum 85% driver efficiency. Standard 0-10V dimming with 1-100% range; 0.2mA maximum source current.

TUNABLE DRIVER OPTIONS:

TWO = 2 CHANNEL 0-10V one channel for brightness, one channel for CCT

TWD = 2 CHANNEL DALI8 one channel for brightness, one channel for CCT

INSTALLATION: Recessed drywall and grid installation. Frame adjustable ceiling thickness 0.5" to 1.25".


WARRANTY: 5 Year Warranty.

LABEL: Fixture is certified to UL standards by Intertek Testing Laboratory for wet location installations. IP65 Rating (from the room-side) per IEC60598. Meets ISO3/Class 1 Cleanroom Standards. Certified for NSF2 Splash Zone/ Non-Food Zones. This product is Made in America and complies with Buy American Act (BAA).

DIMENSIONAL DATA

NON-IC CONSTRUCTION



IC CONSTRUCTION

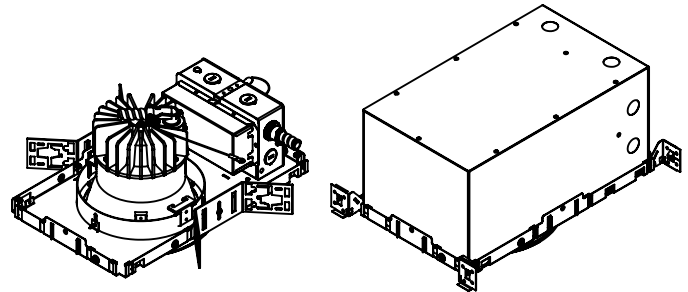

4" DOWNLIGHT

4" SQUARE



4" ROUND

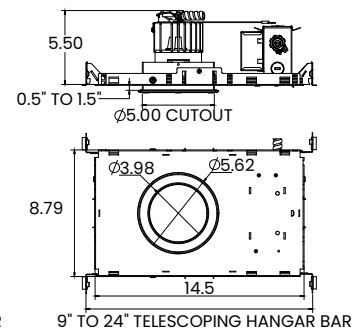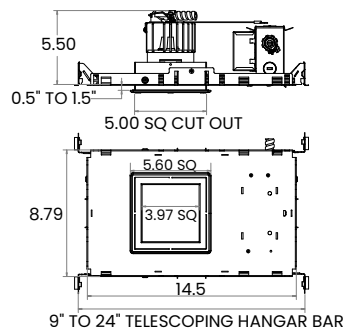

6" DOWNLIGHT

6" SQUARE

6" ROUND

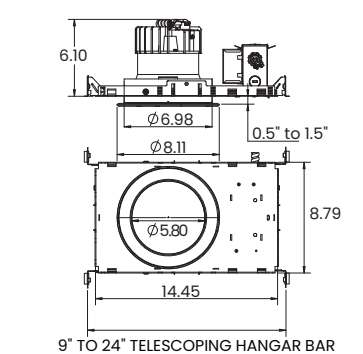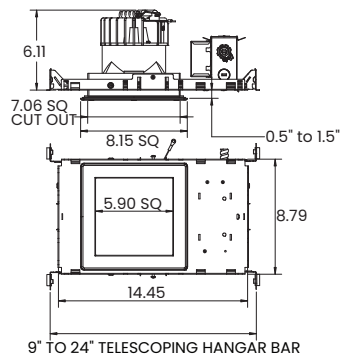

New Star Lighting

2225 W Pershing Rd, Chicago, IL 60609
(773) 847-1400
www.newstarlighting.com

Specifications and dimensions are subject to change without notice. For additional options and dimensional details, please consult your New Star Lighting representative.

© 2026, New Star Lighting. All rights reserved. Unauthorized duplication or distribution is prohibited.

COMPLETECARE™ MRI DOWNLIGHT SERIES

PERFORMANCE DATA

*Data is with 80 CRI chip at 4000K. 6IN Downlight Wide beam, 1500lm Engine, 115lm/W at 18.75W

MODEL	SHAPE	OUTPUT	LUMENS DELIVERED	EFFICACY (lm/W)	INPUT POWER (W)
CCDL-MRI-4	R = Round	LW = Low	1260	84	14
		SD = Standard	1450	83	18
		MD = Medium	1650	81	21
		HG = High	2172	77	28
	S = Square	LW = Low	1257	84	14
		SD = Standard	1525	84	18
		MD = Medium	1750	83	21
		HG = High	2236	79	28
CCDL-MRI-6	R = Round	LW = Low	1405	102	14
		SD = Standard	2081	103	20
		MD = Medium	2736	101	27
		HG = High	4181	96	44
	S = Square	LW = Low	1392	101	14
		SD = Standard	2070	102	20
		MD = Medium	2760	102	27
		HG = High	3990	96	42



New Star Lighting

2225 W Pershing Rd, Chicago, IL 60609
(773) 847-1400
www.newstarlighting.com

Specifications and dimensions are subject to change without notice. For additional options and dimensional details, please consult your New Star Lighting representative.

© 2026, New Star Lighting. All rights reserved. Unauthorized duplication or distribution is prohibited.

POWER SUPPLY SPECIFICATION FEATURES

HOUSING: Galvanized steel housing. The power supply must be installed outside the shielded MRI environment. Housing contains ferrous components that can damage or interfere with MRI equipment.

ELECTRONICS: Input: 120/277V 50/60 HZ. Output: Max (3) 36VDC Constant Current Drivers.

EMI FILTER: MRI Room EMI filter required (supplied by others). Note, each driver requires individual filter.

INSTALLATION: Wiring/Conduit: All power and dimming wiring must be completely shielded in grounded conduit. Minimum 18 AWG low voltage supply wire.

ORDERING INFORMATION

Example: CCDL-4-PS-HC-MD-DM1

CCDL		PS	HC			
Series	Aperature 4 = 4 inch 6 = 6 inch	Power Supply PS = Remote Power Supply	Housing HC = Aluminum Steel	Wattage LW = Low - 14 Watts SD = Standard - 18 Watts MD = Medium - 21 Watts HG = High - 28 Watts	Driver Type DM1 = 0-10V Dimming with 1-100% range DMT = 0-10V & TRIAC/ELV* *Must specify with 120V. Tunable White Driver* TW0 = 2 CHANNEL 0-10V TWD = 2 CHANNEL DALI8 *Tunable White Driver requires choice of TW1 or TW2 in Color Temp column.	Options EM = Emerg. Battery (Remote)* *If stored, batteries should be fully recharged every six months and kept between 0°C-25°C to maintain optimal battery capacity.

--	--	--	--

Number of Fixtures Per Driver*

Driver 1	Driver 2	Driver 3	Driver 4
----------	----------	----------	----------

*Divide the total number of fixtures per driver.
LW (14W) can have up to 3 fixtures per driver
SD (18W) can have up to 3 fixtures per driver
MD (21W) can have up to 2 fixtures per driver
HG (28W) can have up to 1 fixture per driver

Example: 6 fixtures with 14W

Recommended configuration (Uses least amount of drivers = least amount of filters to purchase):

Driver 1 = 3 fixtures, Driver 2 = 3 fixtures, Driver 3 = 0 fixture

Not recommended:

Driver 1 = 2 fixtures, Driver 2 = 2 fixtures, Driver 3 = 2 fixture



New Star Lighting

2225 W Pershing Rd, Chicago, IL 60609
(773) 847-1400
www.newstarlighting.com

Specifications and dimensions are subject to change without notice. For additional options and dimensional details, please consult your New Star Lighting representative.

© 2026, New Star Lighting. All rights reserved. Unauthorized duplication or distribution is prohibited.

CCDL-MRI REMOTE POWER SUPPLY

CCDL-MRI must have a remote Power Supply Box mounted outside the MRI Room. Inside each Power Supply Box are drivers (3 drivers max per box). Each driver can accommodate a certain number of fixtures based on the fixture wattage. When ordering, specifier must determine the quantity of fixtures per driver.

Note, each driver requires a MRI Filter (supplied by others).

MRI downlights available in a 14W, 18W, and 21W and 28W.

LW (14W) can have up to 3 fixtures per driver

SD (18W) can have up to 3 fixtures per driver

MD (21W) can have up to 2 fixtures per driver

HG (28W) can have up to 1 fixture per driver

The number of fixtures must be divided over the 3 drivers. See below configurations and examples.

EXAMPLE 1: CCDL-MRI-4-PS-HC-MD-DMI

MRI Room has four downlights that are MD (27W) specified. Order (1) Power Supply Box and determine number of fixtures per driver.


Each driver can have up to 2 fixtures.

Driver 1 = 2 fixtures

Driver 2 = 2 fixtures

Driver 3 = 0 fixtures

MRI Filters (by others) = 2

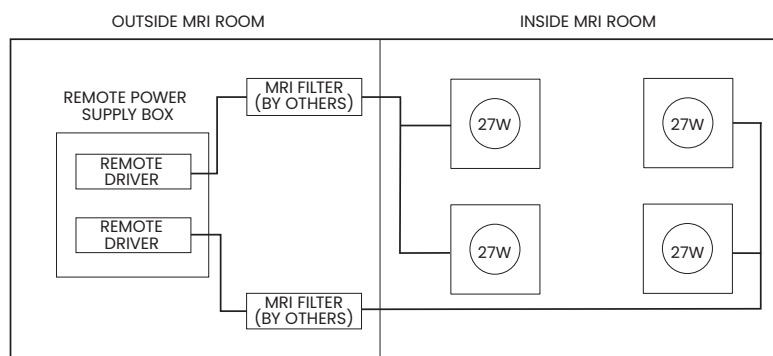

* Diagram is for example purposes only. Other configurations possible. Consult factory for lighting wiring diagrams.

EXAMPLE 1: CCDL-MRI-4-PS-HC-MD-DMI

MRI Room has nine downlights that are LW (14W) specified. Order (1) Power Supply Box and determine number of fixtures per driver.


Each driver can have up to 4 fixtures.

Driver 1 = 3 fixtures

Driver 2 = 3 fixtures

Driver 3 = 3 fixtures

MRI Filters (by others) = 3

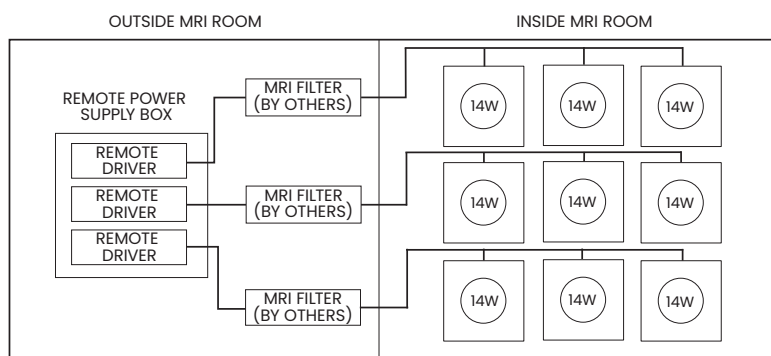

New Star Lighting

2225 W Pershing Rd, Chicago, IL 60609
(773) 847-1400
www.newstarlighting.com

Specifications and dimensions are subject to change without notice. For additional options and dimensional details, please consult your New Star Lighting representative.

© 2026, New Star Lighting. All rights reserved. Unauthorized duplication or distribution is prohibited.

IMPORTANT SAFETY MEASURES

Power supply must be grounded to ensure adequate EMI filtering. Remote Power Supply system must be ordered separately, and installed according to provided instructions.

- This must be installed in accordance with the applicable installation code by a person familiar with the construction and operation of the product and the hazards involved in a MRI environment
- Disconnect power to all circuits before wiring fixture
- Install in accordance with all national, state, and local codes
- Remote Power Supply MUST be grounded
- Failure to install unit on a mechanically sound surface may result in personal injury, physical damage, or potential fire hazard
- Use installation procedures appropriate to a MRI environment and sensitive electronic equipment
- Read all fixture marketing and labels to ensure correct installation of the luminaire
- Supplemental instructions may be located on the luminaire, in addition to the instruction sheet provided by New Star, regarding orientation or mounting restrictions



New Star Lighting

2225 W Pershing Rd, Chicago, IL 60609
(773) 847-1400
www.newstarlighting.com

Specifications and dimensions are subject to change without notice. For additional options and dimensional details, please consult your New Star Lighting representative.

© 2026, New Star Lighting. All rights reserved. Unauthorized duplication or distribution is prohibited.